


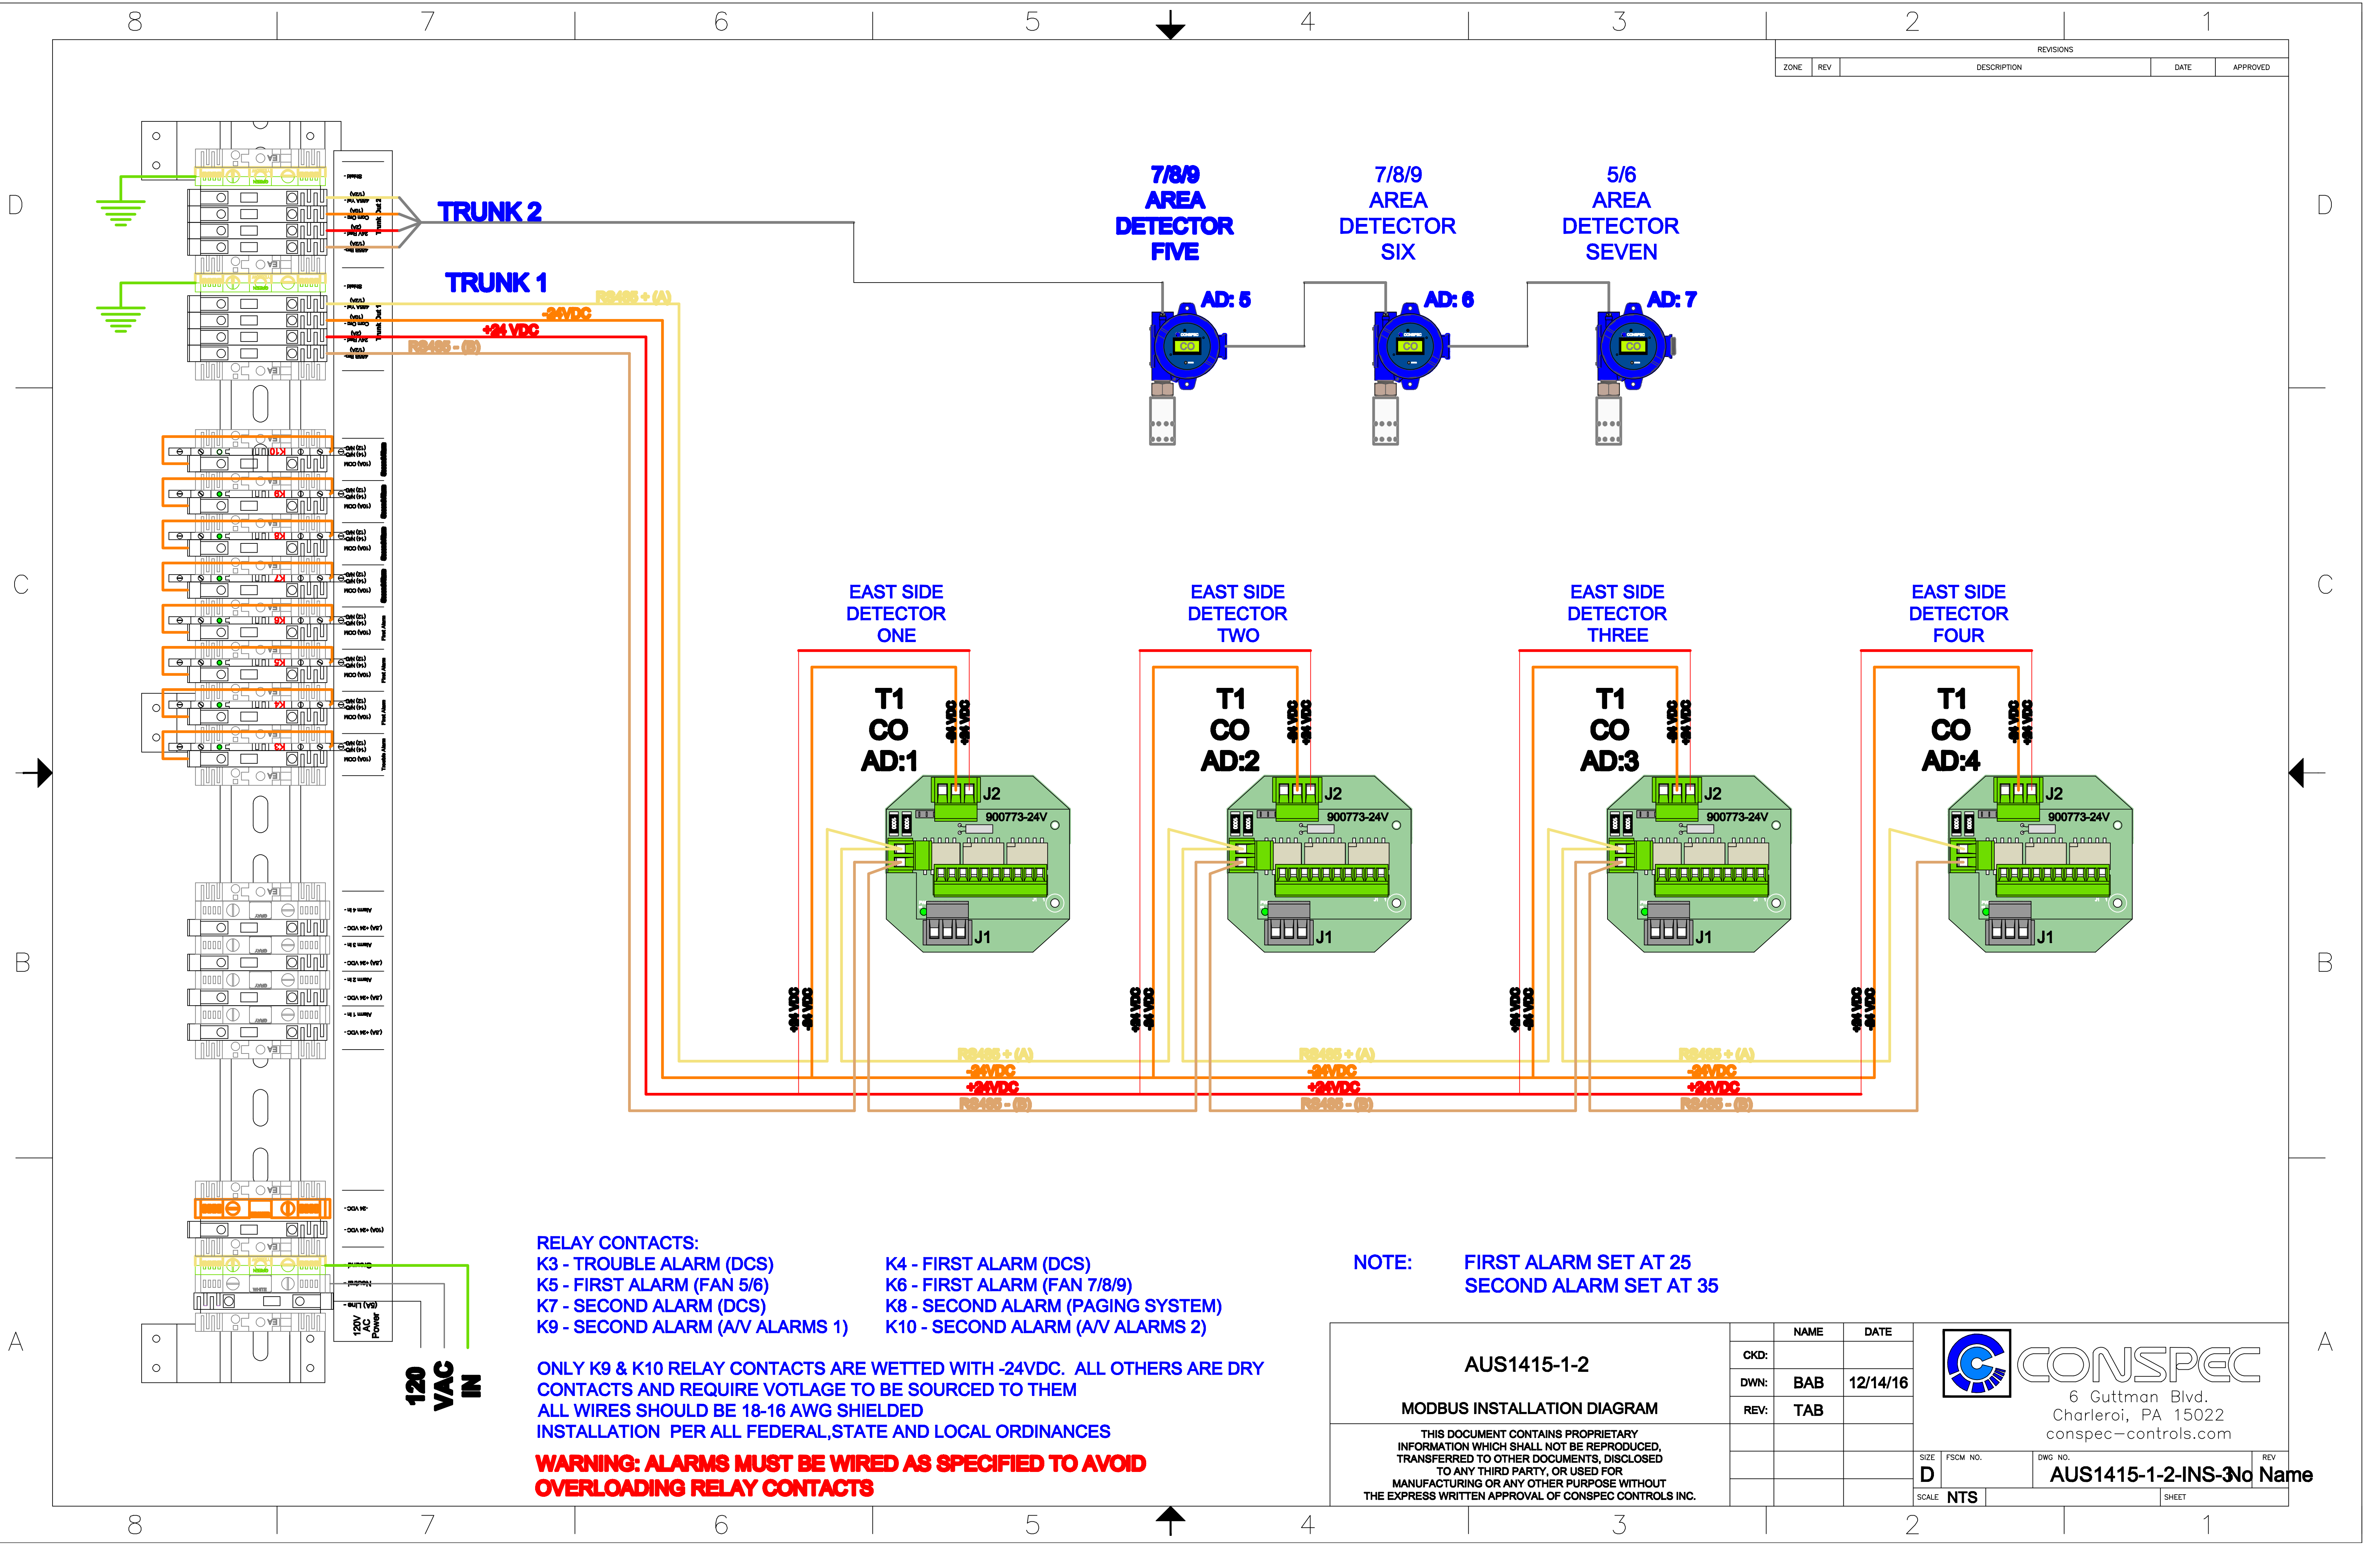

REVISIONS			
ZONE	REV	DESCRIPTION	DATE

- RELAY CONTACTS:
- | | |
|----------------------------------|-----------------------------------|
| K3 - TROUBLE ALARM (DCS) | K4 - FIRST ALARM (DCS) |
| K5 - FIRST ALARM (FAN 5/6) | K6 - FIRST ALARM (FAN 7/8/9) |
| K7 - SECOND ALARM (DCS) | K8 - SECOND ALARM (PAGING SYSTEM) |
| K9 - SECOND ALARM (A/V ALARMS 1) | K10 - SECOND ALARM (A/V ALARMS 2) |

NOTE: FIRST ALARM SET AT 25
SECOND ALARM SET AT 35

ONLY K9 & K10 RELAY CONTACTS ARE WETTED WITH -24VDC. ALL OTHERS ARE DRY CONTACTS AND REQUIRE VOLTAGE TO BE SOURCED TO THEM
ALL WIRES SHOULD BE 18-16 AWG SHIELDED
INSTALLATION PER ALL FEDERAL, STATE AND LOCAL ORDINANCES

WARNING: ALARMS MUST BE WIRED AS SPECIFIED TO AVOID OVERLOADING RELAY CONTACTS

AUS1415-1-2		NAME	DATE
MODBUS INSTALLATION DIAGRAM		CKD:	
THIS DOCUMENT CONTAINS PROPRIETARY INFORMATION WHICH SHALL NOT BE REPRODUCED, TRANSFERRED TO OTHER DOCUMENTS, DISCLOSED TO ANY THIRD PARTY, OR USED FOR MANUFACTURING OR ANY OTHER PURPOSE WITHOUT THE EXPRESS WRITTEN APPROVAL OF CONSPEC CONTROLS INC.		DWN: BAB	12/14/16
		REV: TAB	
		SIZE	FSCM NO.
		DWG NO.	REV
		AUS1415-1-2-INS-3	No Name
		SCALE	SHEET

CONSPEC
6 Guttman Blvd.
Charleroi, PA 15022
conspec-controls.com