


AUSID09.dwg

D

C

B

A

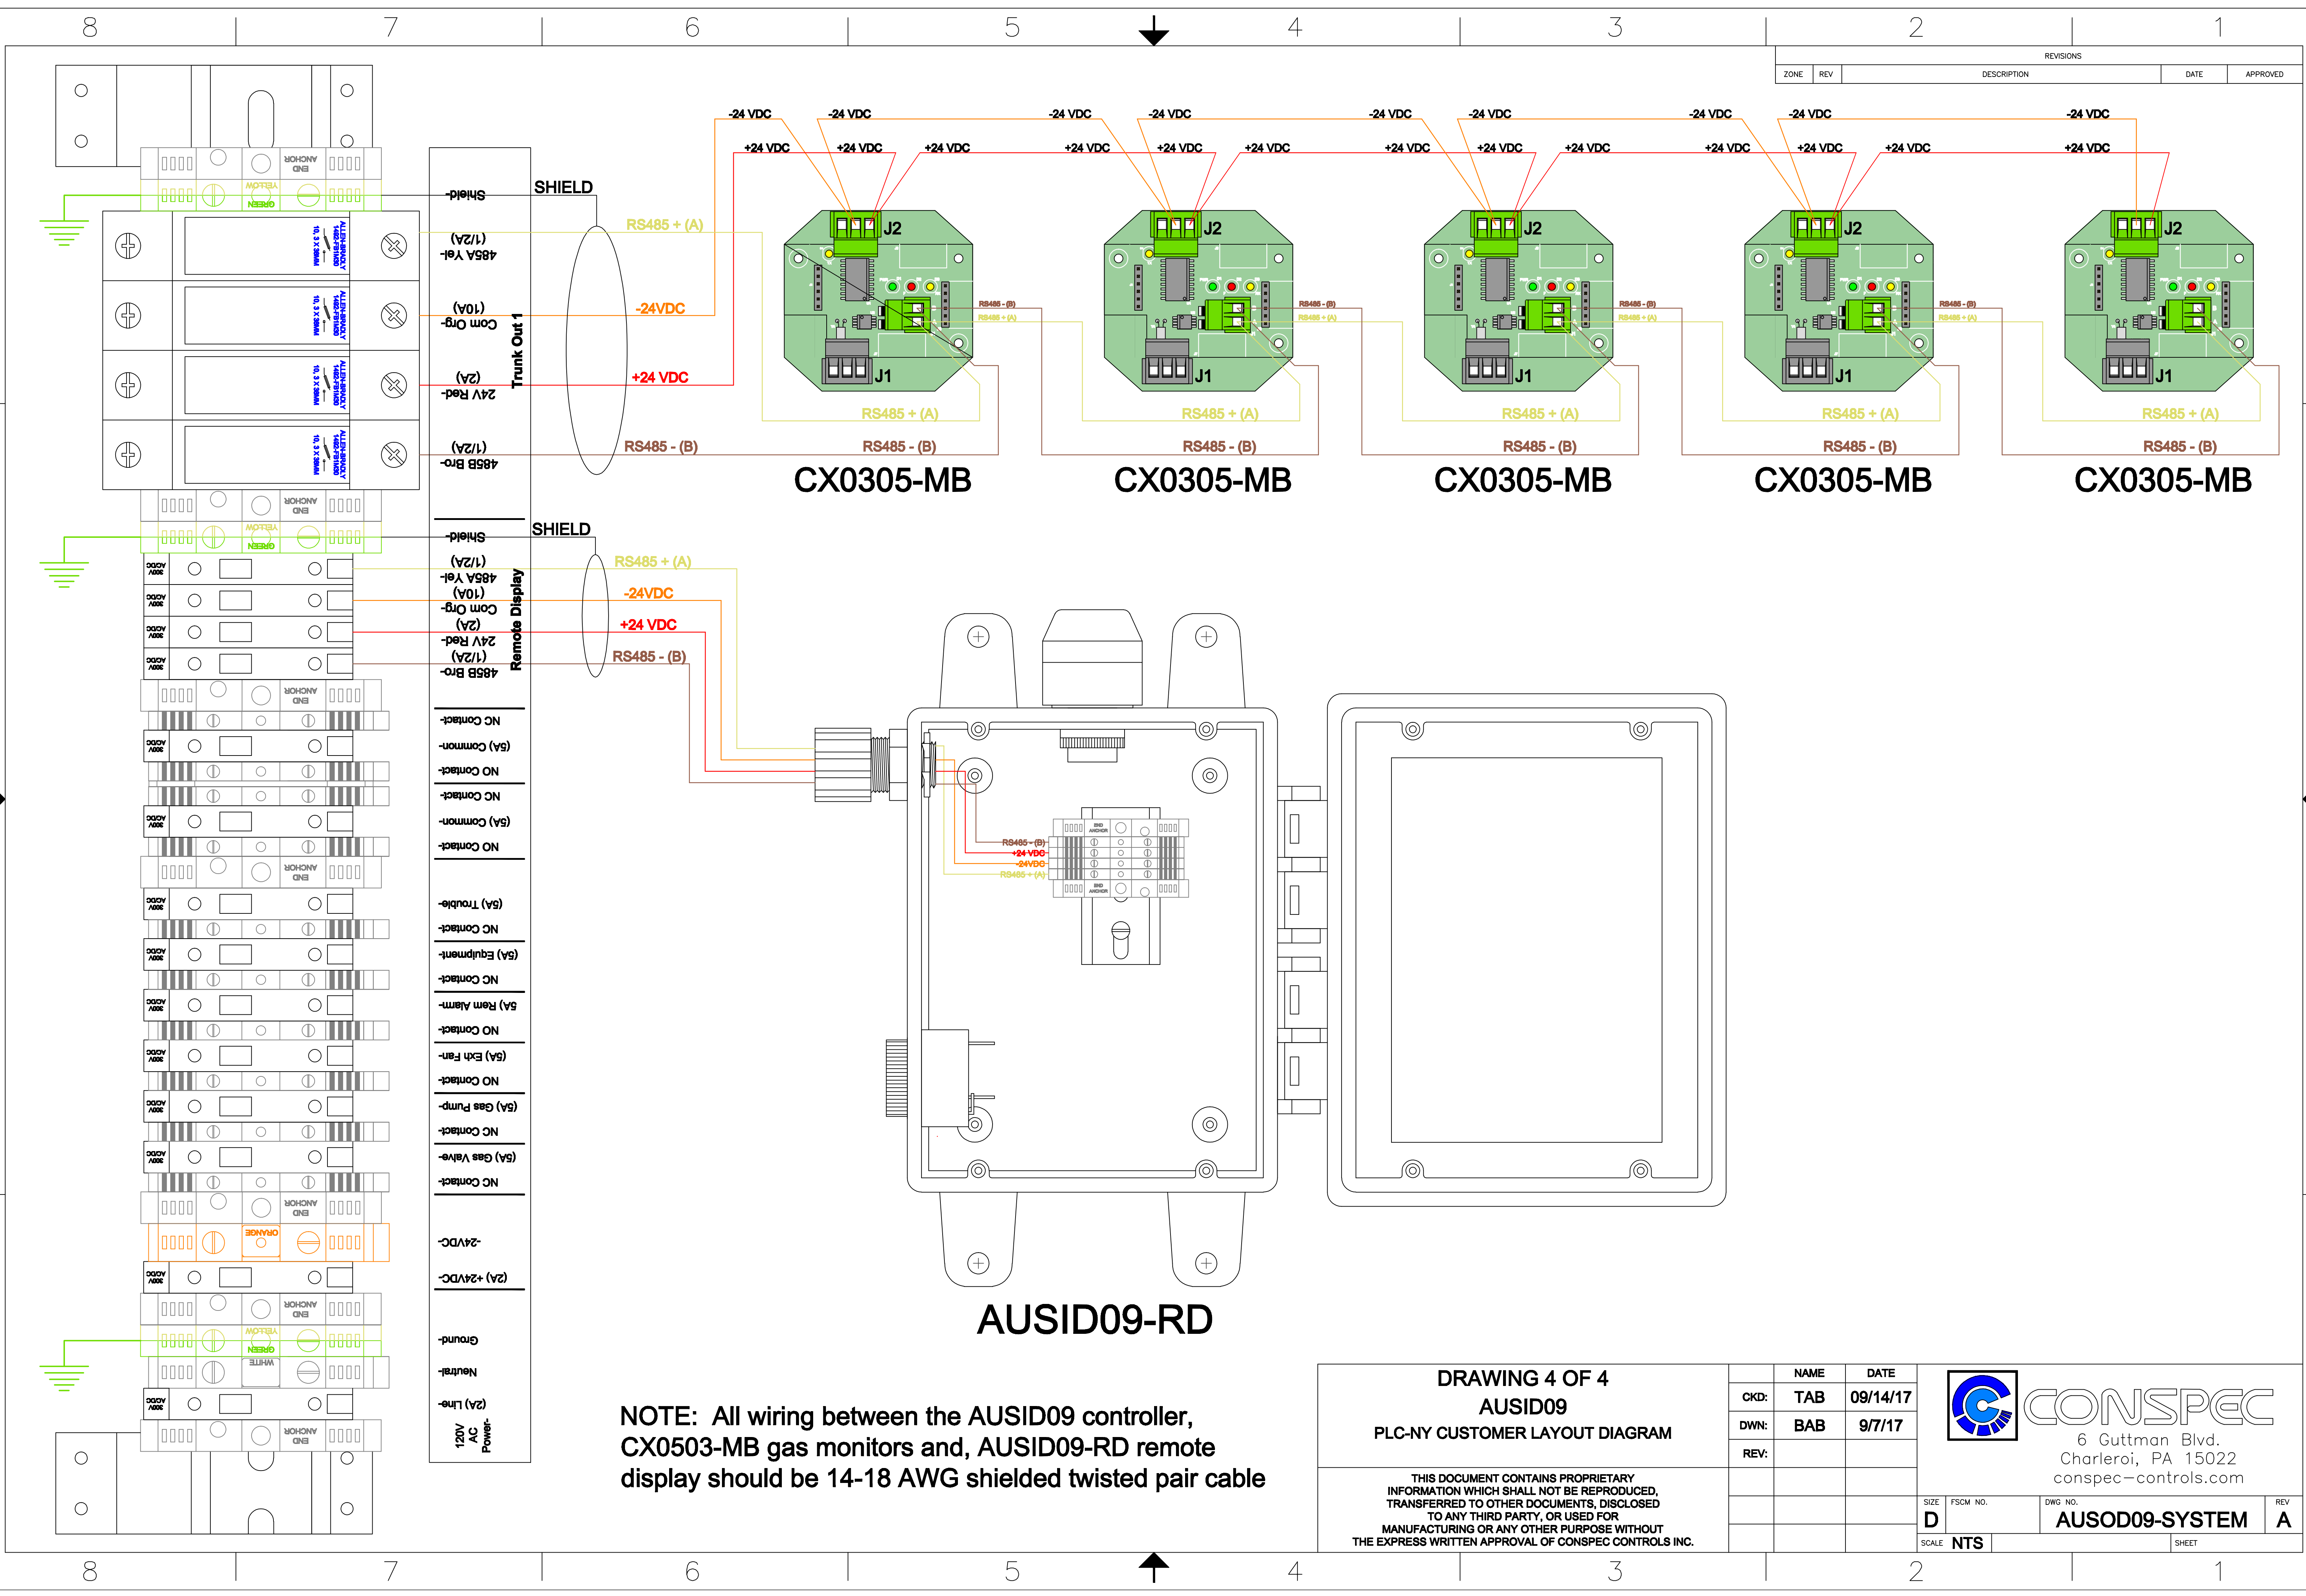

NOTE: All wiring between the AUSID09 controller, CX0503-MB gas monitors and, AUSID09-RD remote display should be 14-18 AWG shielded twisted pair cable

**DRAWING 4 OF 4**  
**AUSID09**  
PLC-NY CUSTOMER LAYOUT DIAGRAM

THIS DOCUMENT CONTAINS PROPRIETARY INFORMATION WHICH SHALL NOT BE REPRODUCED, TRANSFERRED TO OTHER DOCUMENTS, DISCLOSED TO ANY THIRD PARTY, OR USED FOR MANUFACTURING OR ANY OTHER PURPOSE WITHOUT THE EXPRESS WRITTEN APPROVAL OF CONSPEC CONTROLS INC.

|          |          |
|----------|----------|
| NAME     | DATE     |
| CKD: TAB | 09/14/17 |
| DWN: BAB | 9/7/17   |
| REV:     |          |

6 Guttman Blvd.  
Charleroi, PA 15022  
conspec-controls.com

|       |          |                |     |
|-------|----------|----------------|-----|
| SIZE  | FSCM NO. | DWG NO.        | REV |
| D     |          | AUSOD09-SYSTEM | A   |
| SCALE | NTS      | SHEET          |     |